

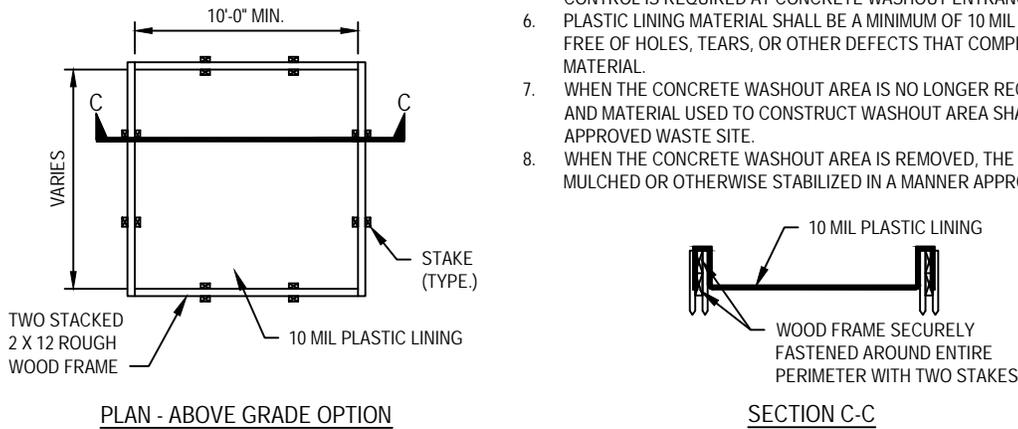


CONCRETE WASHOUT AREA INSTALLATION NOTES:

1. THE CONCRETE WASHOUT AREA SHALL BE INSTALLED PRIOR TO ANY CONCRETE PLACEMENT ON SITE.
2. THE CONCRETE WASHOUT AREA WILL BE CONSTRUCTED ABOVE GRADE OR BELOW GRADE AT THE OPTION OF THE CONTRACTOR. THE ACTUAL LAYOUT SHALL BE DETERMINED IN THE FIELD.
3. THE CONCRETE WASHOUT AREA SHALL BE CONSTRUCTED AND MAINTAINED IN SUFFICIENT SIZE TO CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY WASHOUT OPERATIONS. THE WASHOUT AREA MUST BE CLEANED, OR A NEW WASHOUT AREA MUST BE CONSTRUCTED AND READY FOR USE ONCE THE WASHOUT IS 75% FULL.
4. THE CONCRETE WASHOUT SIGN SHALL BE PLACED WITHIN 30' OF THE WASHOUT AREA. ADDITIONAL SIGNS SHOULD BE CONSTRUCTED AS NECESSARY TO CLEARLY INDICATE THE LOCATION OF THE CONCRETE WASHOUT AREA TO OPERATORS OF CONCRETE TRUCKS AND PUMP RIGS.
5. THE CONCRETE WASHOUT AREA SHALL BE LOCATED A MINIMUM OF 50 FEET FROM STORM DRAIN INLETS, OPEN DISCHARGE FACILITIES, AND WATERCOURSES. EACH FACILITY SHOULD BE LOCATED AWAY FROM CONSTRUCTION TRAFFIC OR ACCESS TO PREVENT DISTURBANCE OR TRACKING. VEHICLE TRACKING CONTROL IS REQUIRED AT CONCRETE WASHOUT ENTRANCE IF ACCESS TO AREA IS OFF PAVEMENT.
6. PLASTIC LINING MATERIAL SHALL BE A MINIMUM OF 10 MIL POLYETHYLENE SHEETING AND SHALL BE FREE OF HOLES, TEARS, OR OTHER DEFECTS THAT COMPROMISE THE IMPERMEABILITY OF THE MATERIAL.
7. WHEN THE CONCRETE WASHOUT AREA IS NO LONGER REQUIRED FOR WORK, THE HARDENED CONCRETE AND MATERIAL USED TO CONSTRUCT WASHOUT AREA SHALL BE REMOVED AND DISPOSED OF AT AN APPROVED WASTE SITE.
8. WHEN THE CONCRETE WASHOUT AREA IS REMOVED, THE DISTURBED AREA SHALL BE SEEDED AND MULCHED OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE ENGINEER.

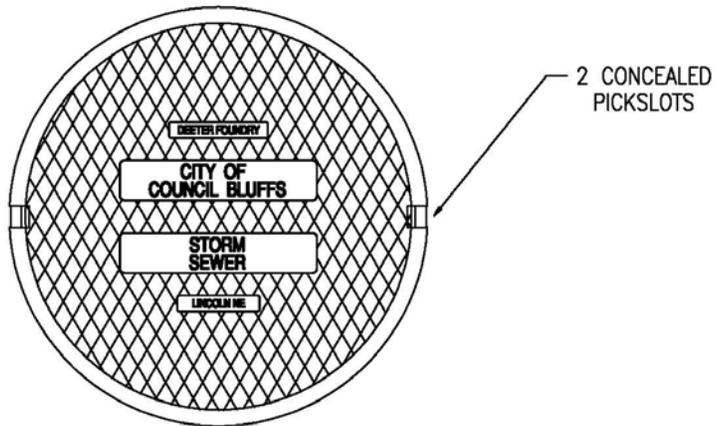


CONCRETE WASHOUT AREA

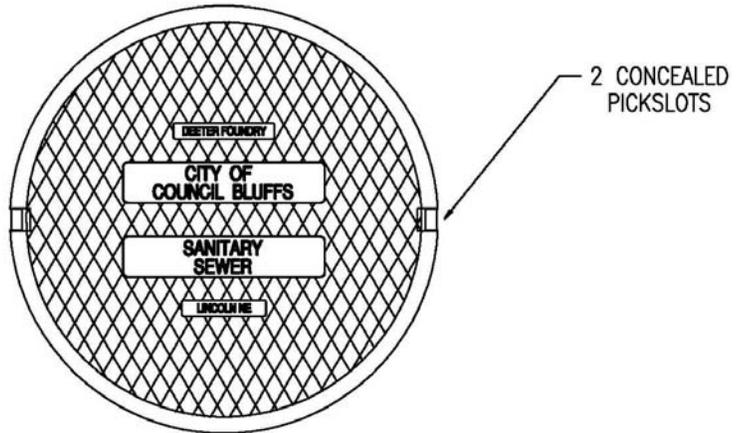

Note: For Casting Details see SUDAS Standard Specifications

CITY OF COUNCIL BLUFFS MANHOLE COVERS

CITY OF COUNCIL BLUFFS PUBLIC WORKS

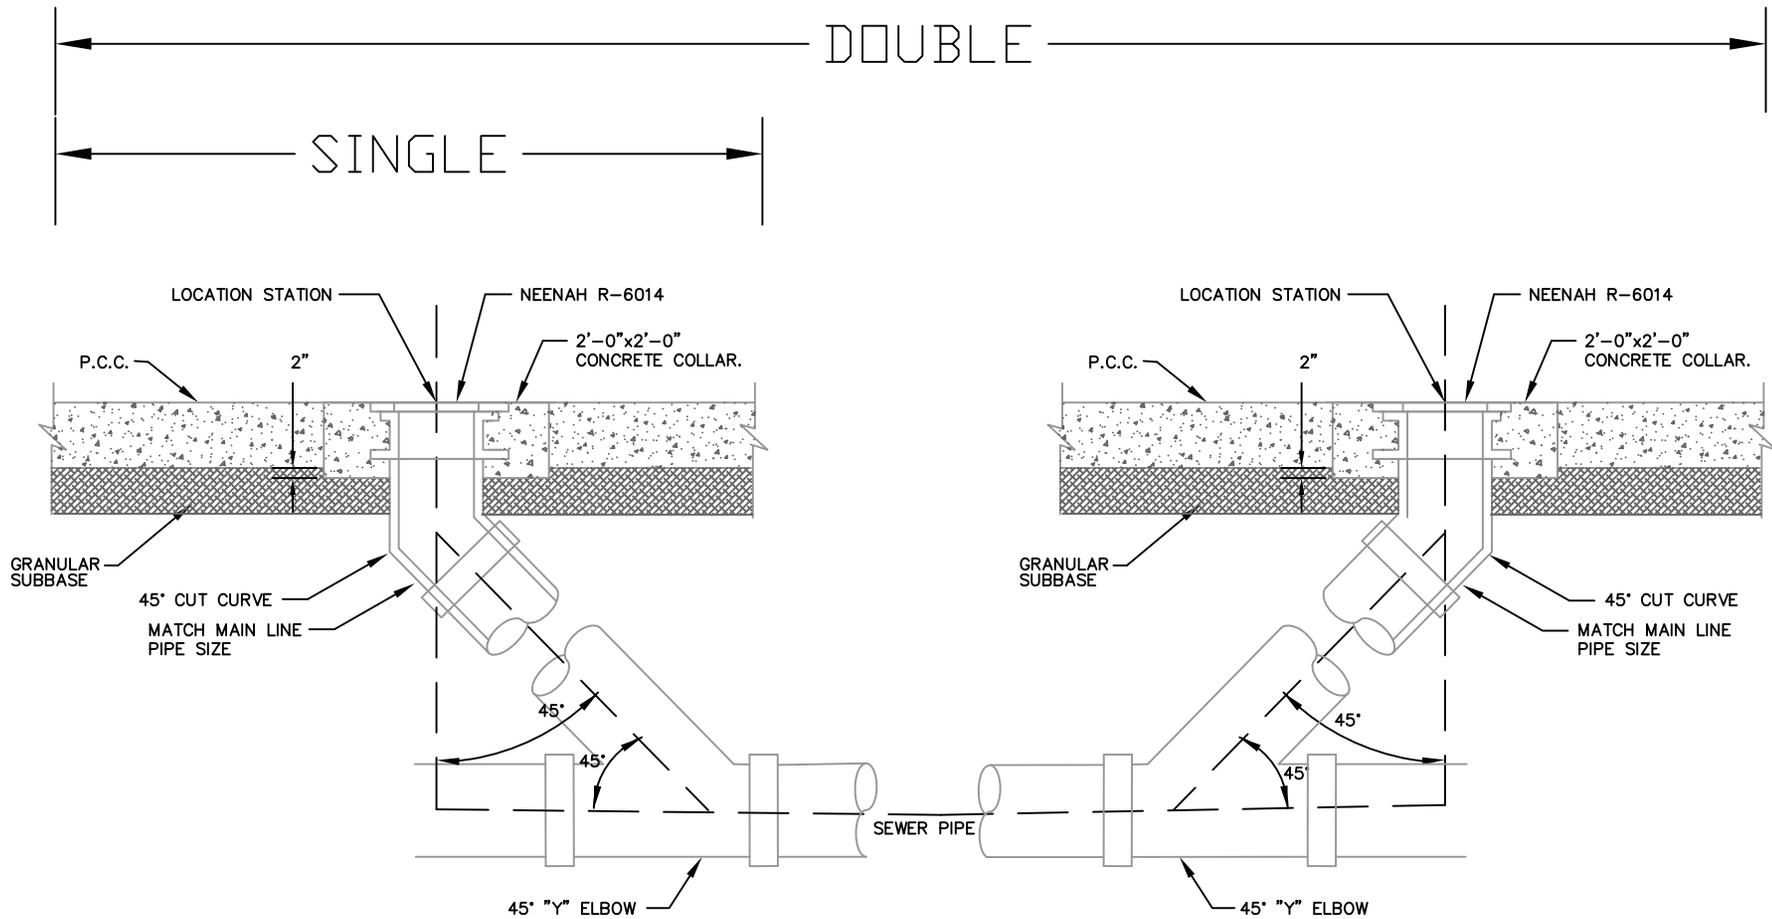

DOUBLE SANITARY SEWER CLEANOUT

NO SCALE:

FIGURE 4010.-1.08K